

INSTALLATION INSTRUCTIONS

Model # 8900/8901/8903

READ AND SAVE THESE INSTRUCTIONS

WARNING! SHUT POWER OFF AT FUSE OR CIRCUIT BREAKER.

AVERTISSEMENT! COUPER LE COURANT AU NIVEAU DES FUSIBLES OU DU DISJONCTEUR.

PREPARING FOR INSTALLATION (Fig. 1)

1. Shut off power at the circuit breaker and remove the old fixture including the mounting hardware.
2. Carefully unpack your new fixture and lay out all the parts in a clear area. Take care not to misplace any small parts necessary for installation.
3. Thread the two studs (E) into the pre-drilled holes in the circular strap (B) spaced the same distance apart as the holes in the fixture back plate. The length of studs (E) into circular strap (B) may be adjusted if necessary.
4. Attach circular strap (B) using outlet box screws (C) to the outlet box (A) (Fig 1).



CONNECTING THE WIRES (Fig. 2)

5. Connect the electrical wires as shown in Fig.2. making sure that all wire connectors are secured. If your outlet box has a ground wire (green or bare copper), connect the fixture's ground wire to it. Otherwise, connect the fixture's ground wire directly to the long strap using the green screw (H) provided.

COMPLETING THE INSTALLATION (Fig. 1)

6. To prevent moisture from entering the outlet box (A) and causing a short, use clear silicone sealant to outline the outside of fixture back plate where it meets the wall leaving a space at bottom to allow moisture a means to escape.
7. Align the fixture back plate onto studs (E) and secure with cap nuts (F). (Fig 1)
8. At this point, unscrew the top finial (Q) to remove rubber washer (N), decorative cover (M), decorative ring (J) and top cover (K).
9. Install the light bulbs in accordance with the fixture specification--**DO NOT EXCEED THE MAXIMUM WATTAGE RATING! (NE PAS DEPASSER LA PUISSANCE NOMINALE MAXIMALE!)**
10. Replace decorative ring (J), top cover (K), decorative cover (M) and rubber washer (N) and secure with finial (Q).

Your installation is now complete. Return power to the outlet box and test the fixture.

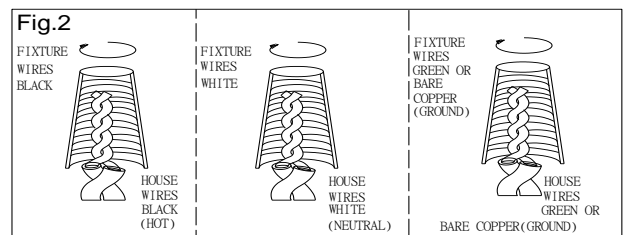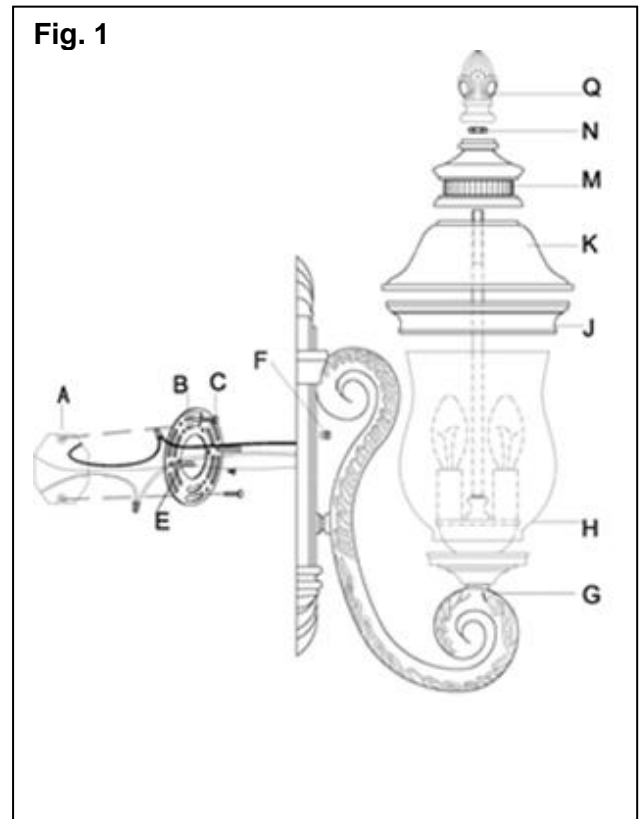

“CAUTION-RISK OF FIRE CONSULT A QUALIFIED ELECTRICIAN TO ENSURE CORRECT BRANCH CIRCUIT CONDUCTOR”

ATTENTION – RISQUE D’INCENDIE. CONSULTER UN ÉLECTRICIEN QUALIFIÉ POUR VOUS ASSURER QUE LES CONDUCTEURS DE LA DÉRIVATION SONT ADÉQUATS.